

COMMONWEALTH OF KENTUCKY
BEFORE THE PUBLIC SERVICE COMMISSION

In the Matter of:

THE APPLICATION OF BULLOCK PEN WATER)	
DISTRICT OF GRANT COUNTY, KENTUCKY, FOR)	
ORDER APPROVING CONSTRUCTION, FINANCING)	CASE NO. 92-477
AND CERTIFICATE OF PUBLIC CONVENIENCE AND)	
NECESSITY)	

O R D E R

Bullock Pen Water District ("Bullock Pen") has requested a deviation from Commission Regulation 807 KAR 5:066, Section 10(2)(b), which states the conditions under which a utility may install fire hydrants. Bullock Pen states that the proposed fire hydrants are intended for flushing purposes only and not for fire protection.

After reviewing the evidence of record and being sufficiently advised, the Commission finds that:

1. Commission Regulation 807 KAR 5:066, Section 10(2)(b), permits a utility to install fire hydrants only if: a professional engineer with a Kentucky registration has certified that the system can provide a minimum fire flow of 250 gallons per minute and the system supporting this flow has the capability of providing this flow for a period of not less than two hours plus consumption at the maximum daily rate.

2. Bullock Pen cannot certify that its system meets the requirements of Commission Regulation 807 KAR 5:066, Section 10(2)(b).

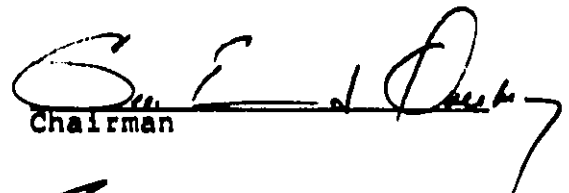
3. Bullock Pen has failed to show good cause why a deviation of Commission Regulation 807 KAR 5:066, Section 10(2)(b), should be granted.

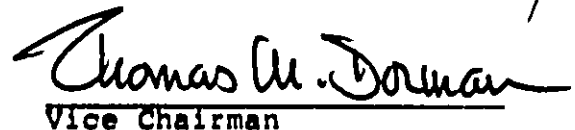
4. Bullock Pen's request for deviation from Commission Regulation 807 KAR 5:066, Section 10(2)(b), should be denied.

IT IS THEREFORE ORDERED that Bullock Pen's request for deviation from Commission Regulation 807 KAR 5:066, Section 10(2)(b), is denied.

Done at Frankfort, Kentucky, this 17th day of March, 1993.

PUBLIC SERVICE COMMISSION


Chairman


Vice Chairman


Commissioner

ATTEST:


Executive Director